


ConCore®: CC1000 Panel-24"

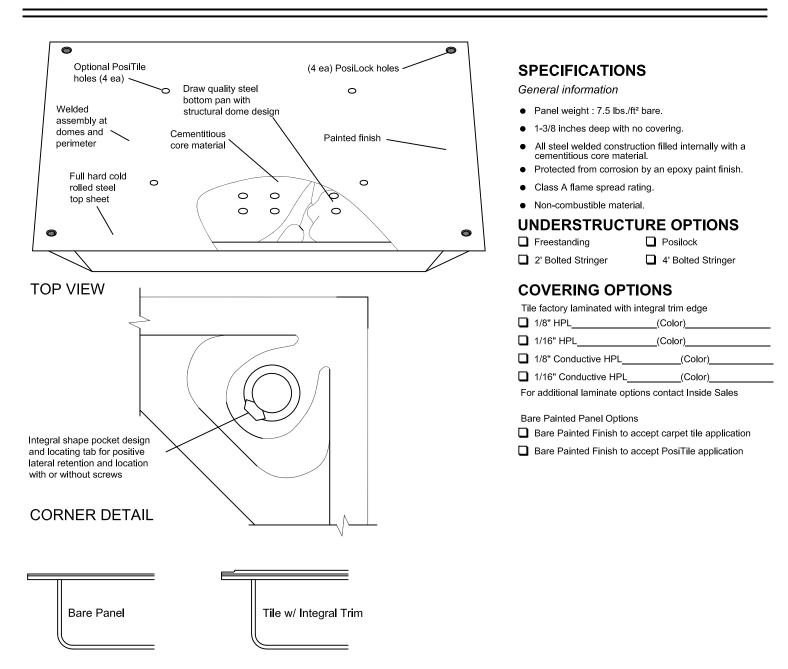

System Performance Criteria

System performance criteria are the most important to consider because they represent the performance in a typical installation. Panel only criteria such as concentrated load is often used to specify floor systems however, the test is not representative of an actual installation because it is performed with the panel resting on blocks, not actual understructure.

System Performance Criteria (Tested on Actual Understructure)*							
System Type		SYSTEM	STATIC LOADS		ROLLING LOADS		IMPACT
Panel	Understructure	WEIGHT	Design Loads	Safety Factor (min. 2.0)	10 Passes	10,000 Passes	LOADS
ConCore CC1000-24"	Posilock	8.0 lbs / ft² 39 kg / m²	1000 lbs 454 kg	Pass	800 lbs 363 kg	600 lbs 272 kg	150 lbs 68 kg
	Bolted Stringer	9.0 lbs / ft² 44 kg / m²	1000 lbs 454 kg	Pass	800 lbs 363 kg	600 lbs 272 kg	150 lbs 68 kg

^{*}System load definitions and test procedure descriptions can be found in the Standard Product Tests and Methodology Guidelocated in the Resources section of Tate's web-site, www.tateaccessfloors.com.